


Saginaw County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


36 Total Samples



- > 10 3%
- 5-10 22%
- < 5 28%
- Non-Detect 47%



Source: Waterchem database
Map Created November 2019

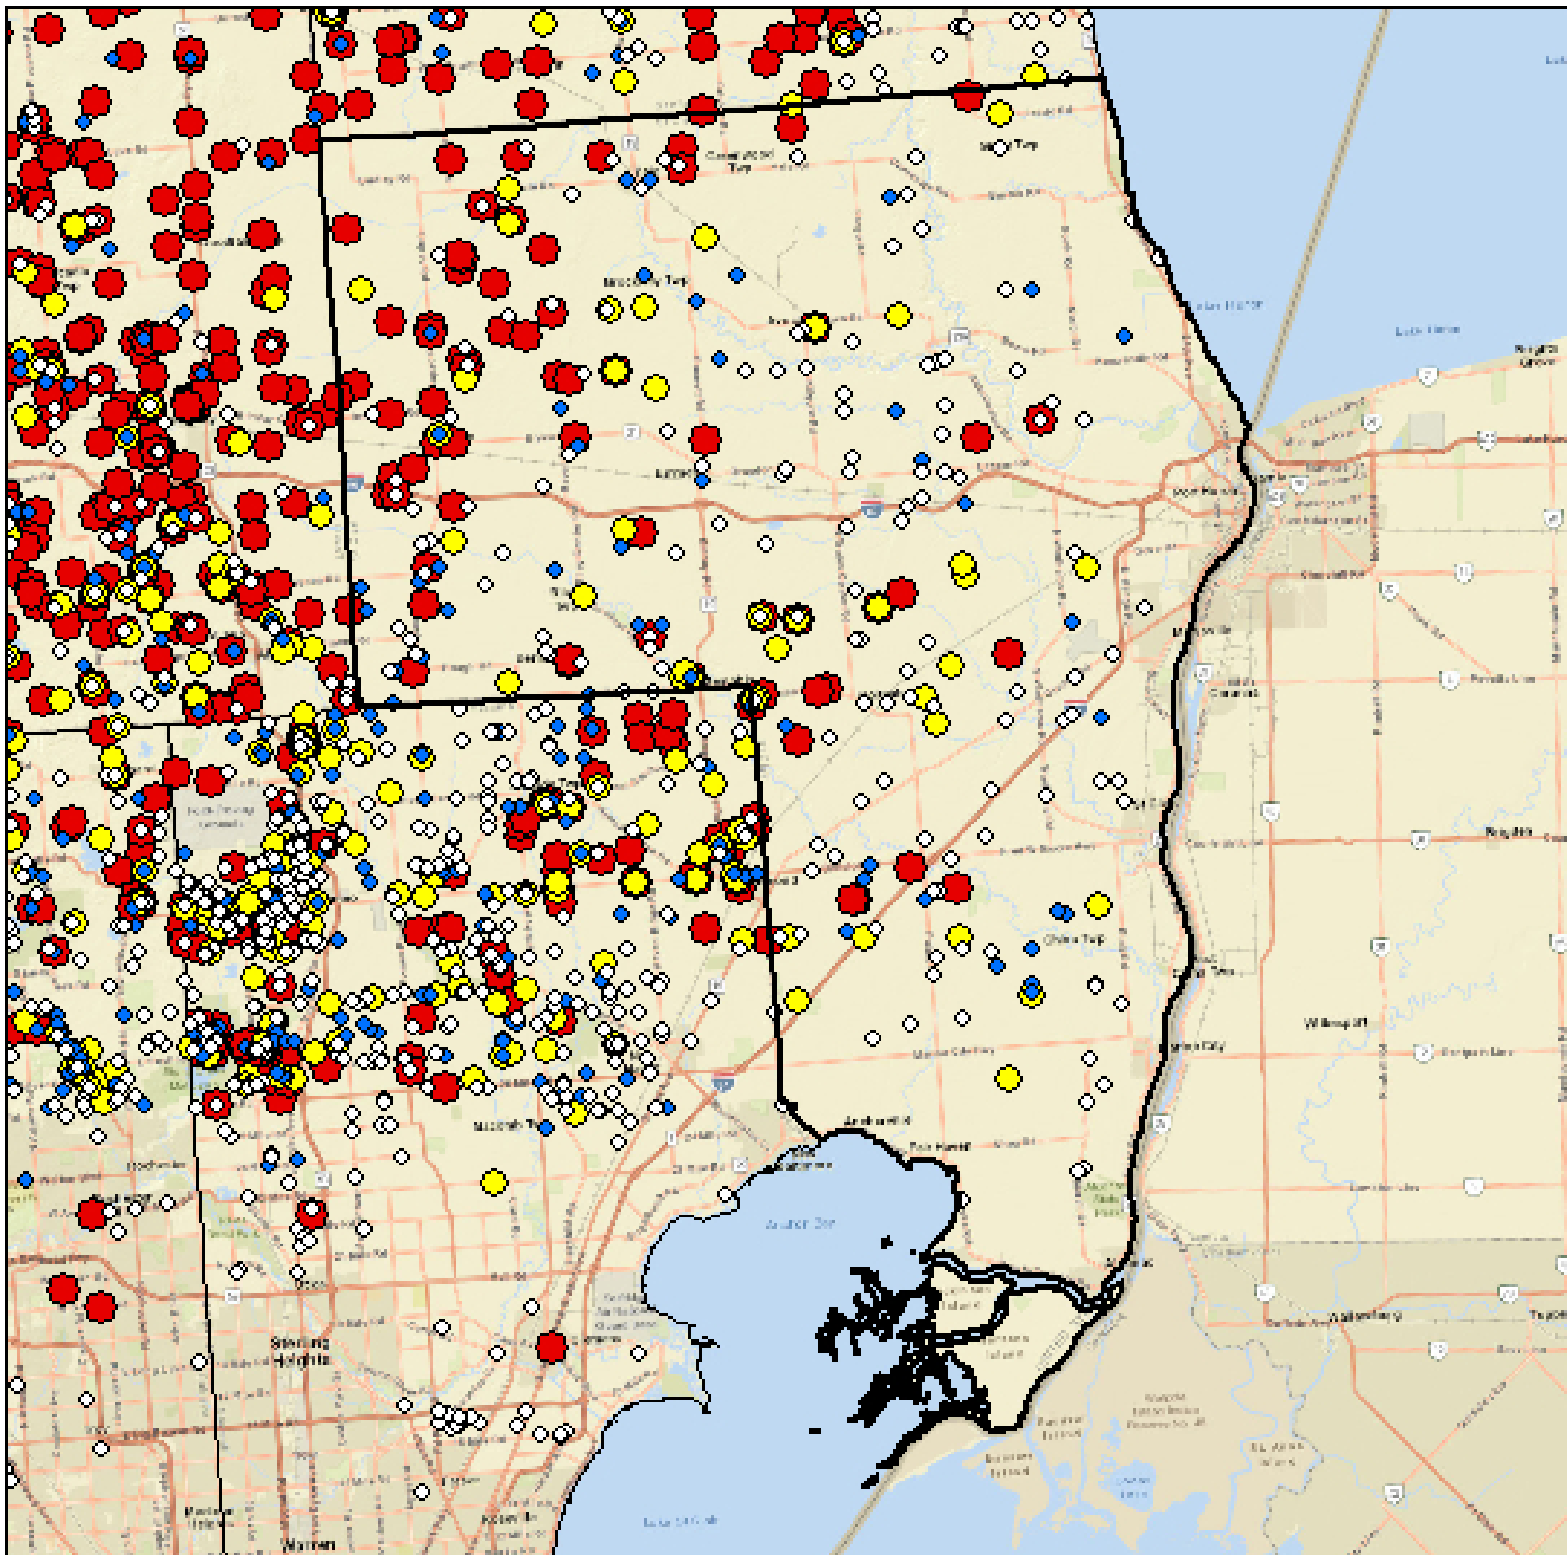


Saint Clair County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


371 Total Samples



- > 10 21%
- 5-10 13%
- < 5 27%
- Non-Detect 39%



Source: Waterchem database
Map Created November 2019

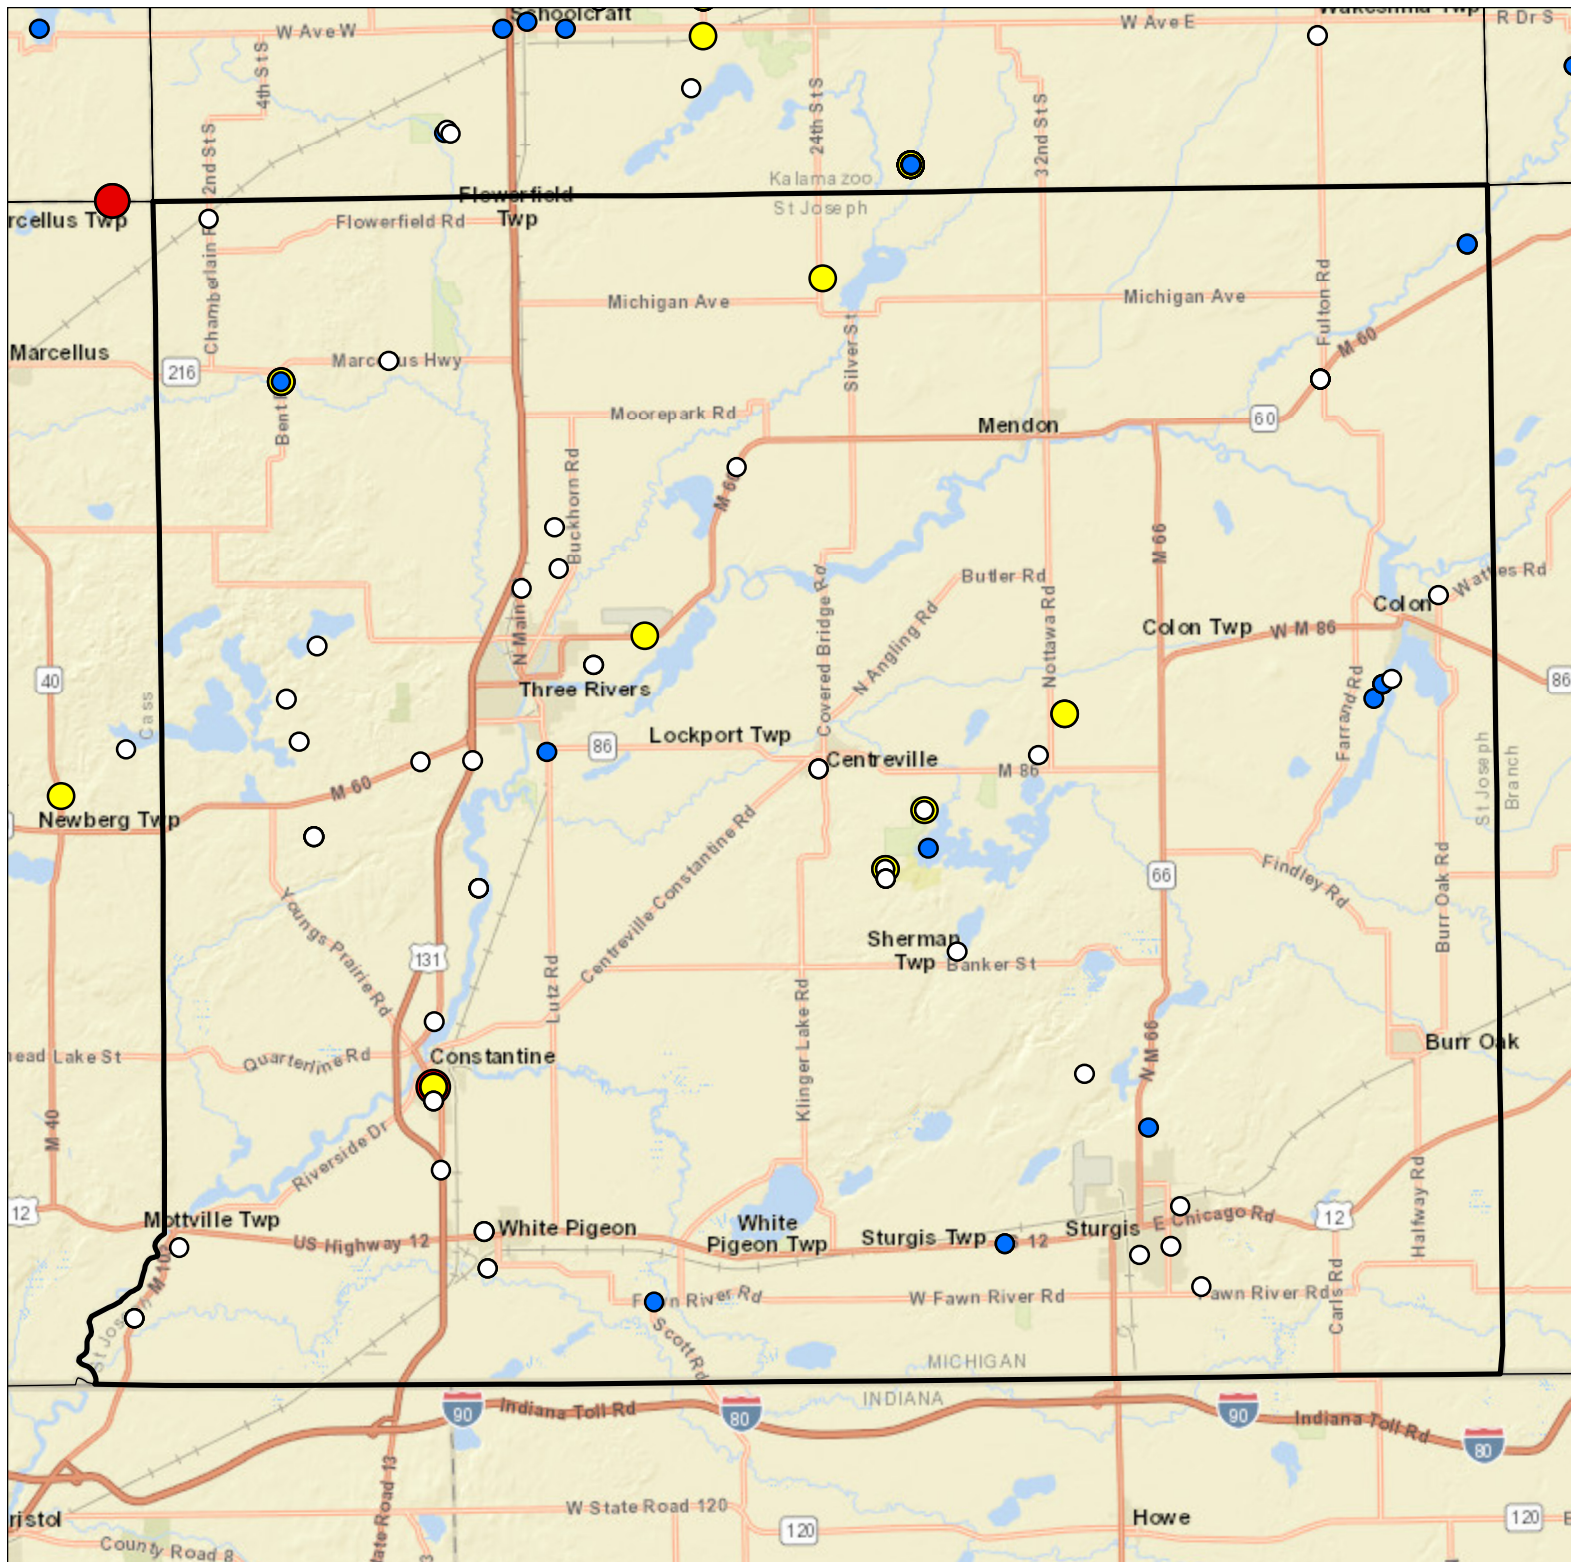


Saint Joseph County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


93 Total Samples



- > 10 1%
- 5-10 16%
- < 5 28%
- Non-Detect 55%



Source: Waterchem database
Map Created November 2019

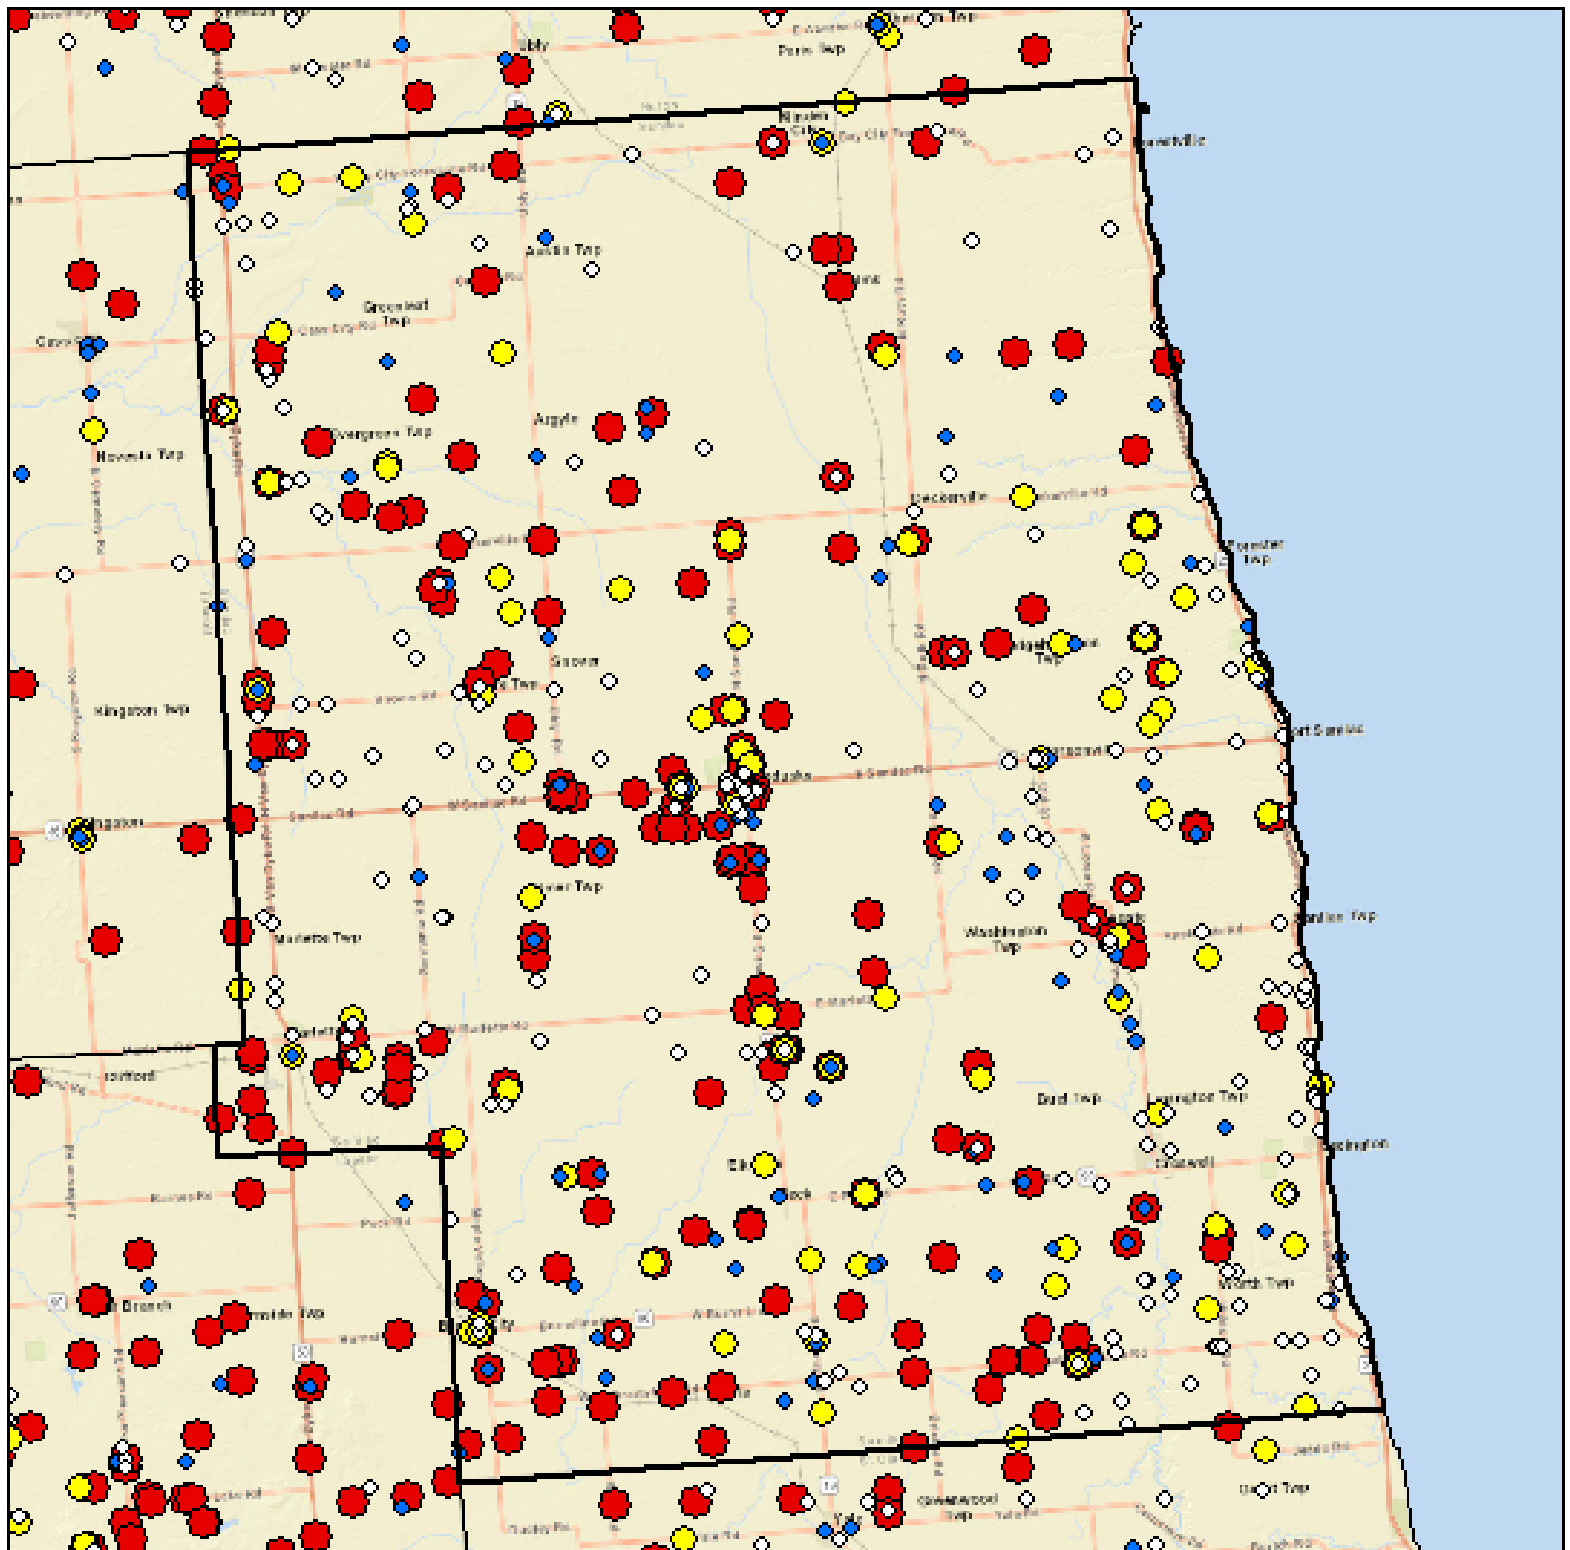


Sanilac County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

1245 Total Samples




- > 10 17%
- 5-10 16%
- < 5 28%
- Non-Detect 39%



0 1.5 3 6 Miles



Source: Waterchem database
Map Created November 2019

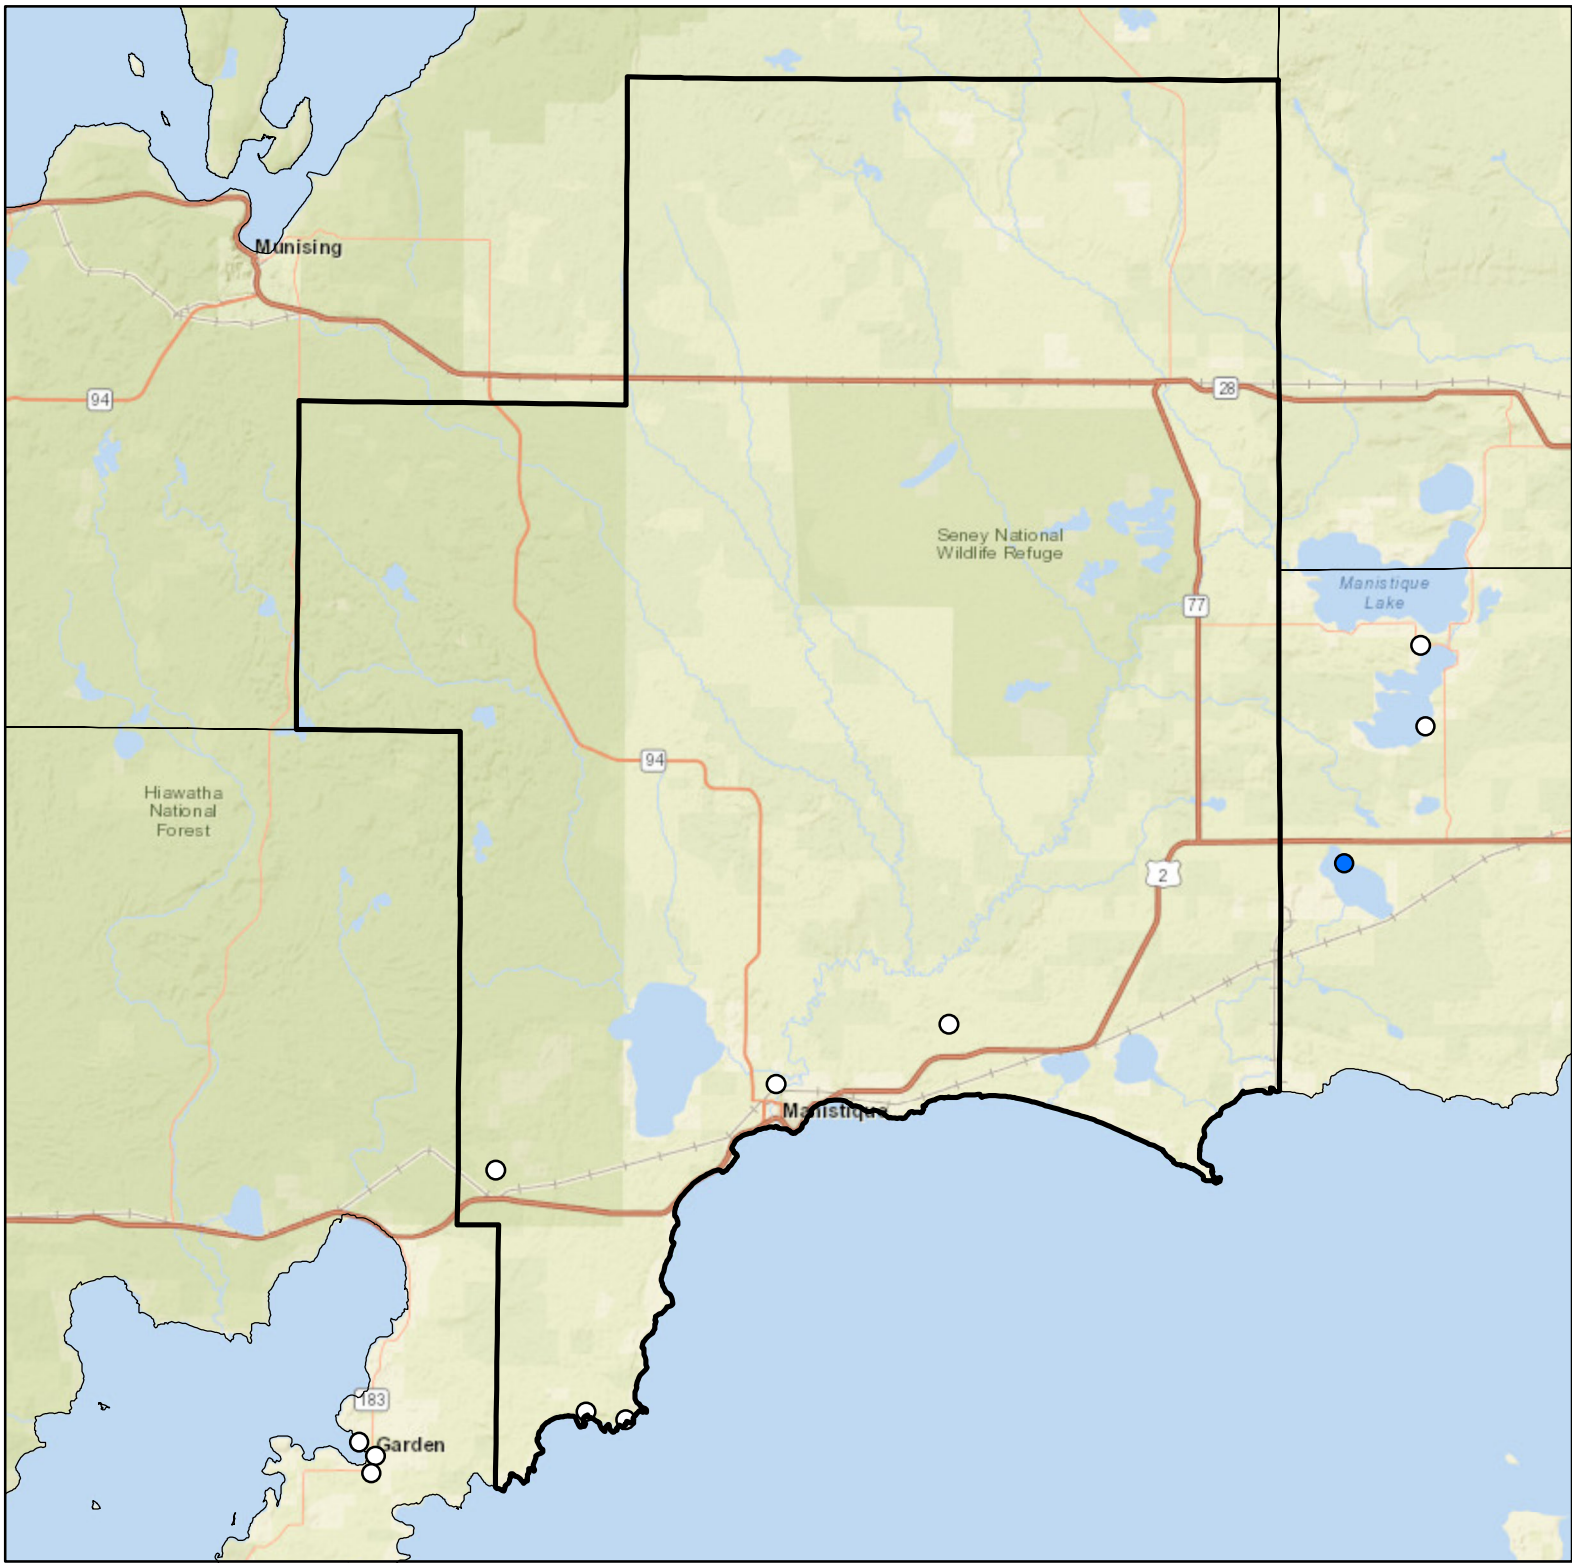


Schoolcraft County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

5 Total Samples




- > 10 0%
- 5-10 0%
- < 5 0%
- Non-Detect 100%



EGLE

0 2 4 8 Miles

Source: Waterchem database
Map Created November 2019

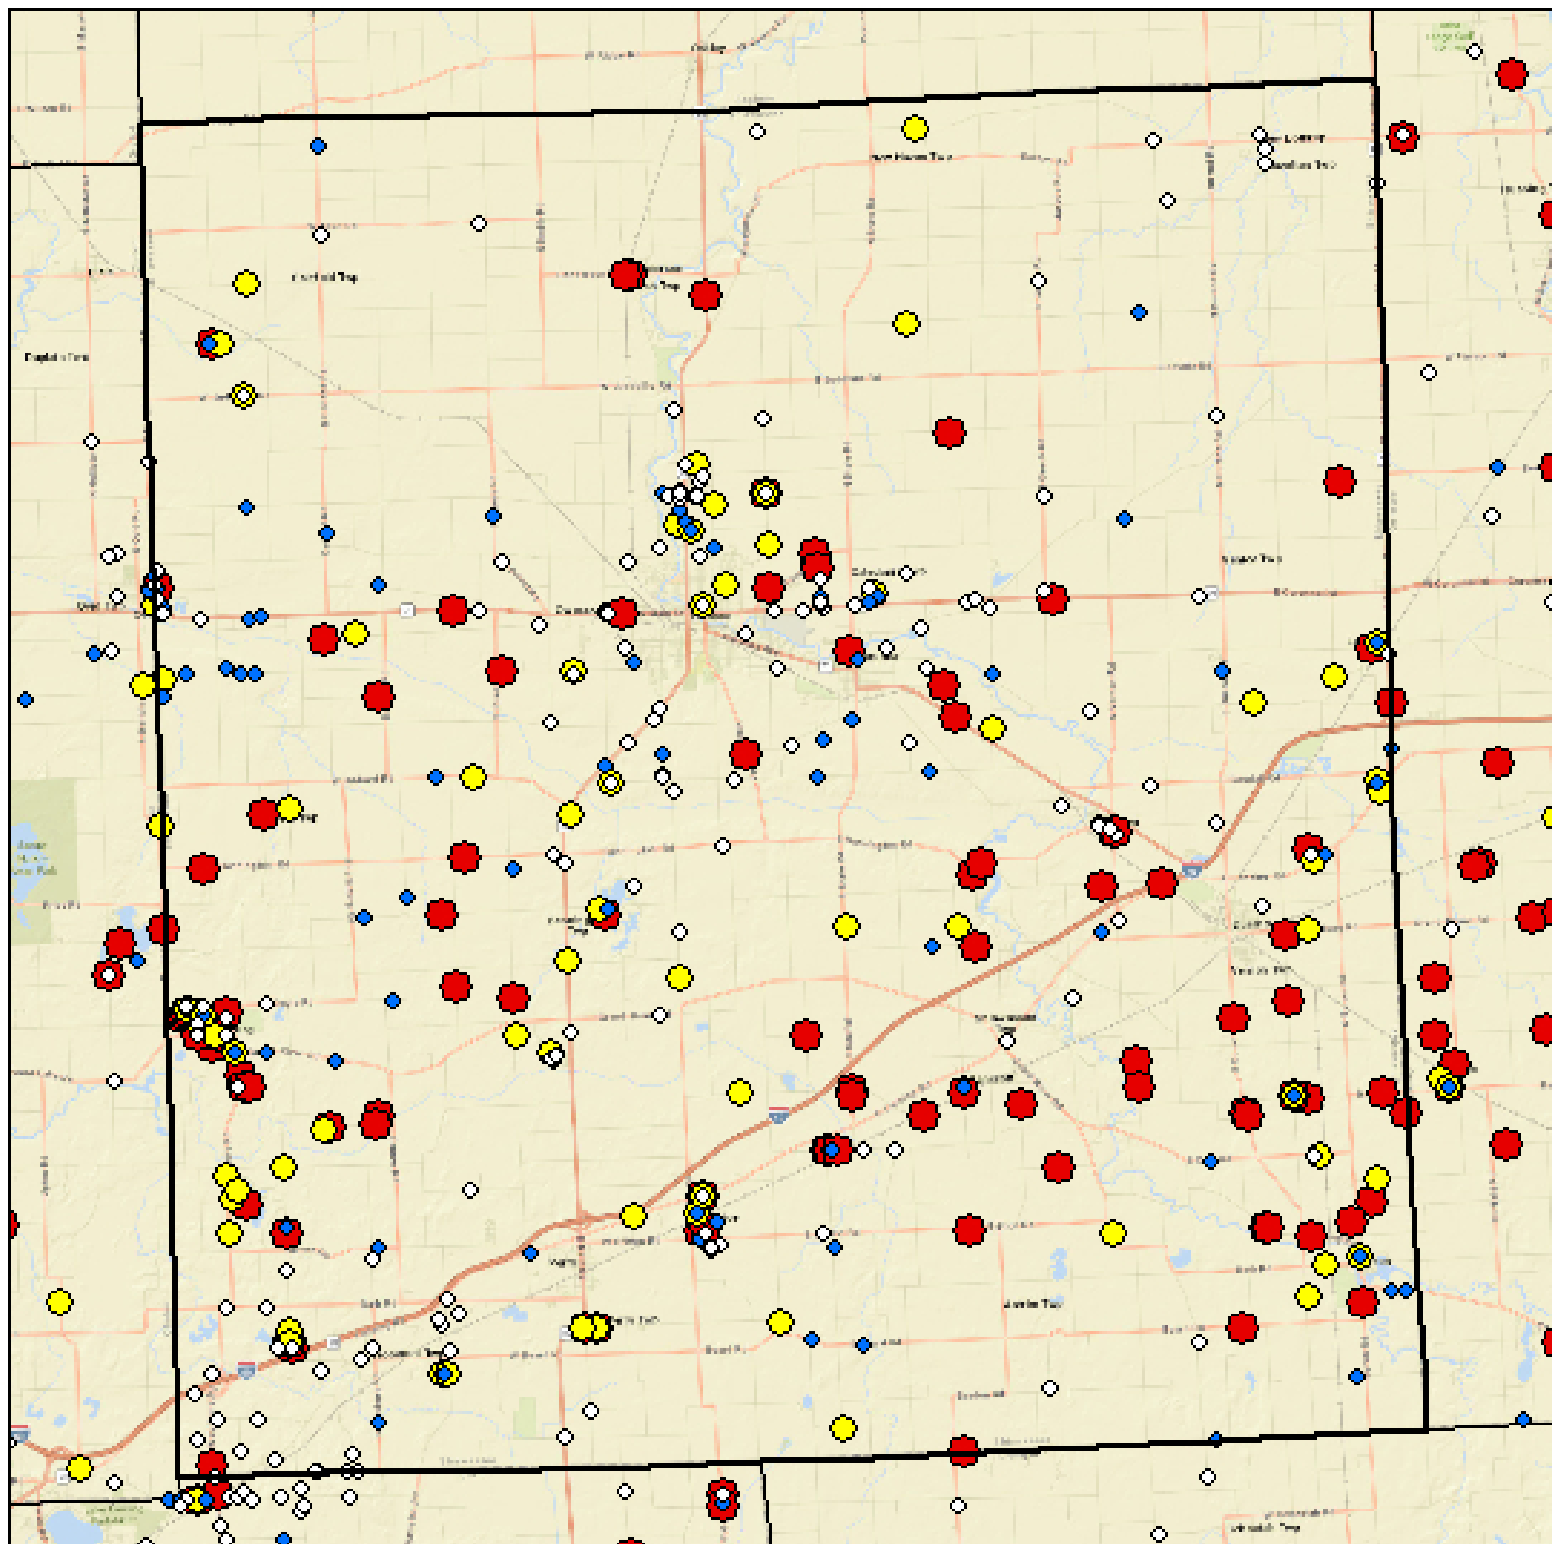


Shiawassee County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

622 Total Samples



- > 10 21%
- 5-10 20%
- < 5 23%
- Non-Detect 36%




EGLE

0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

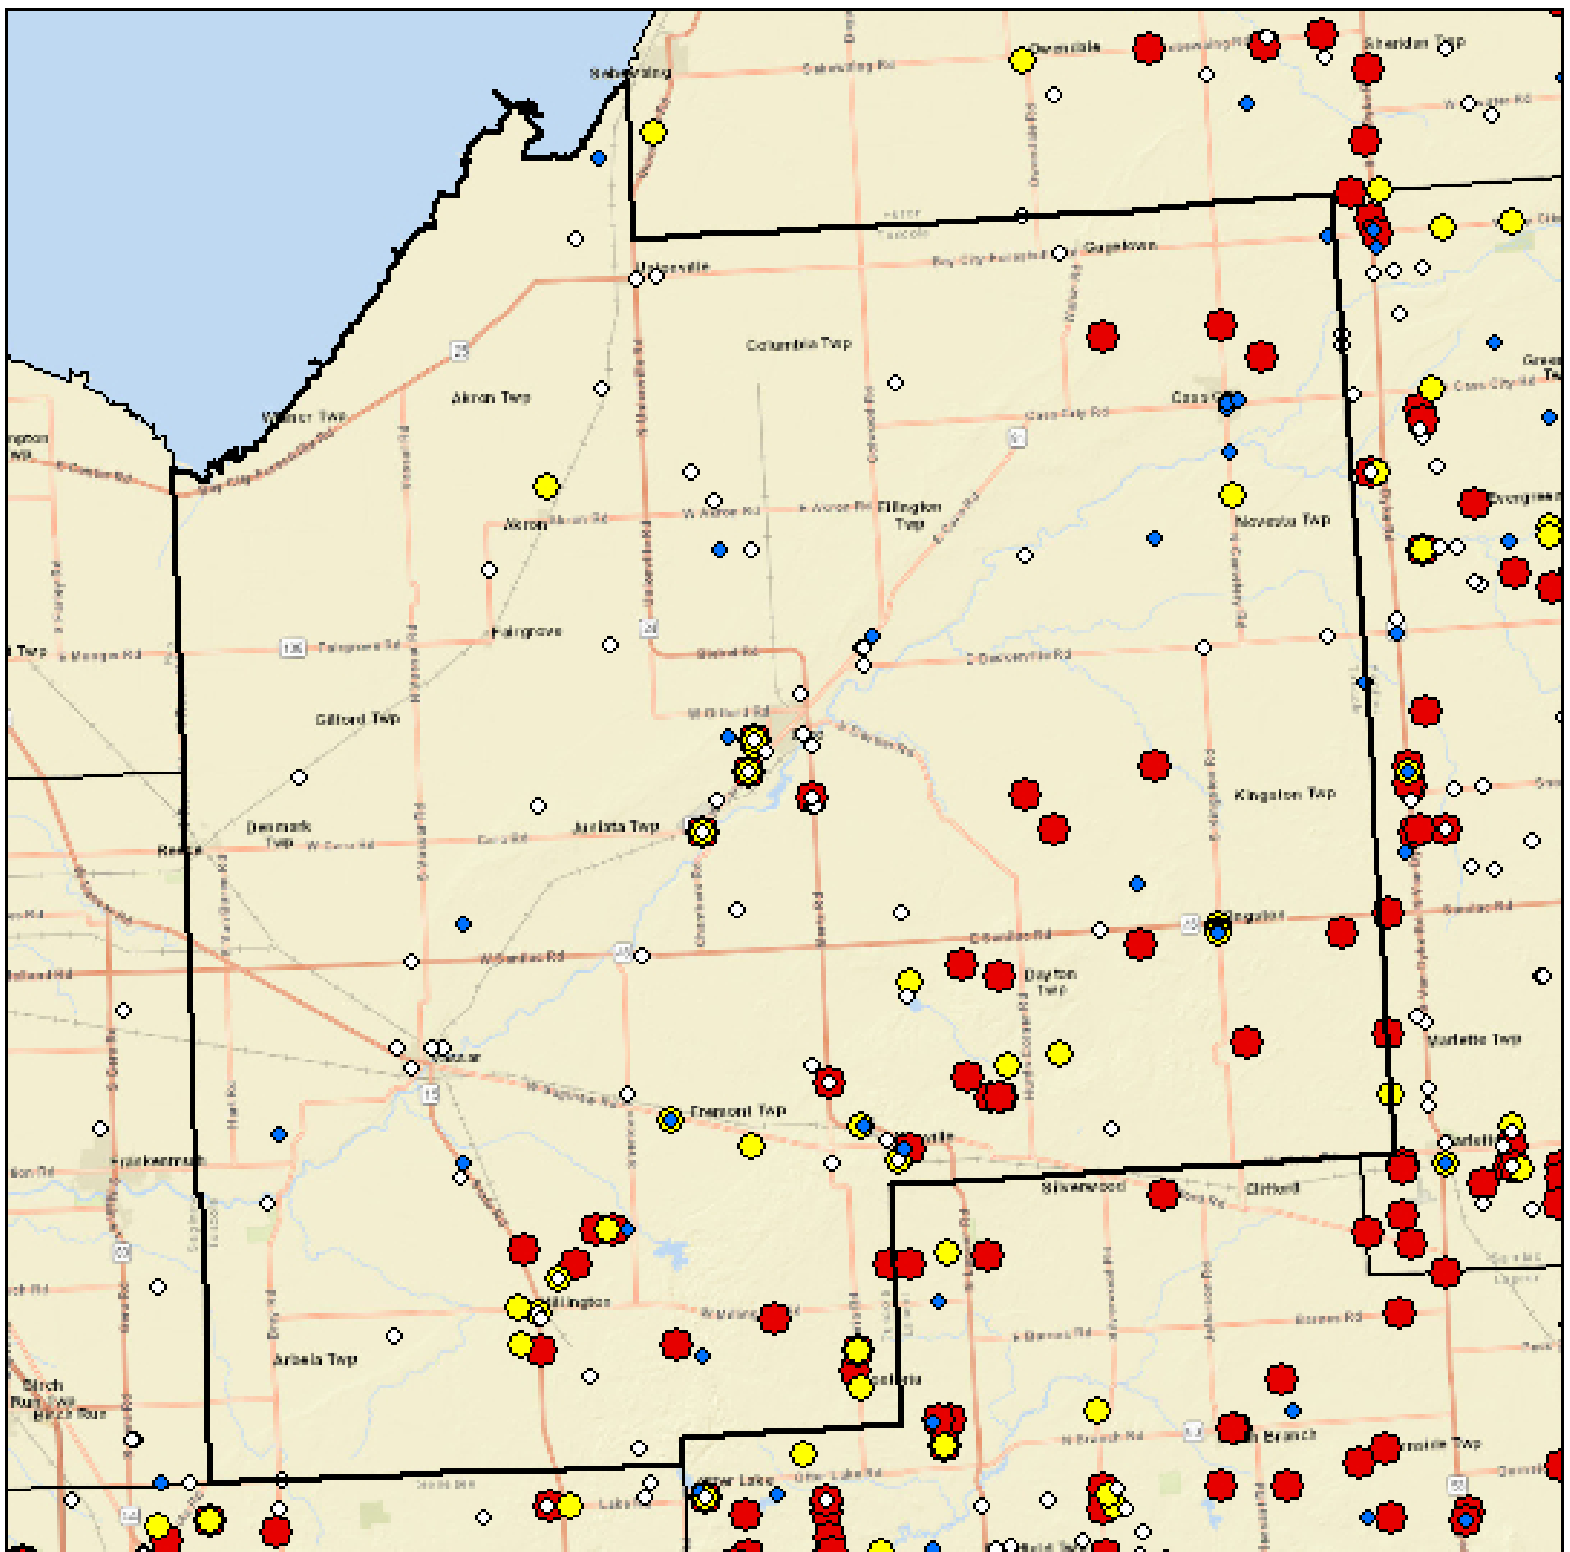


Tuscola County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


536 Total Samples



- > 10 9%
- 5-10 22%
- < 5 30%
- Non-Detect 39%



Source: Waterchem database
Map Created November 2019

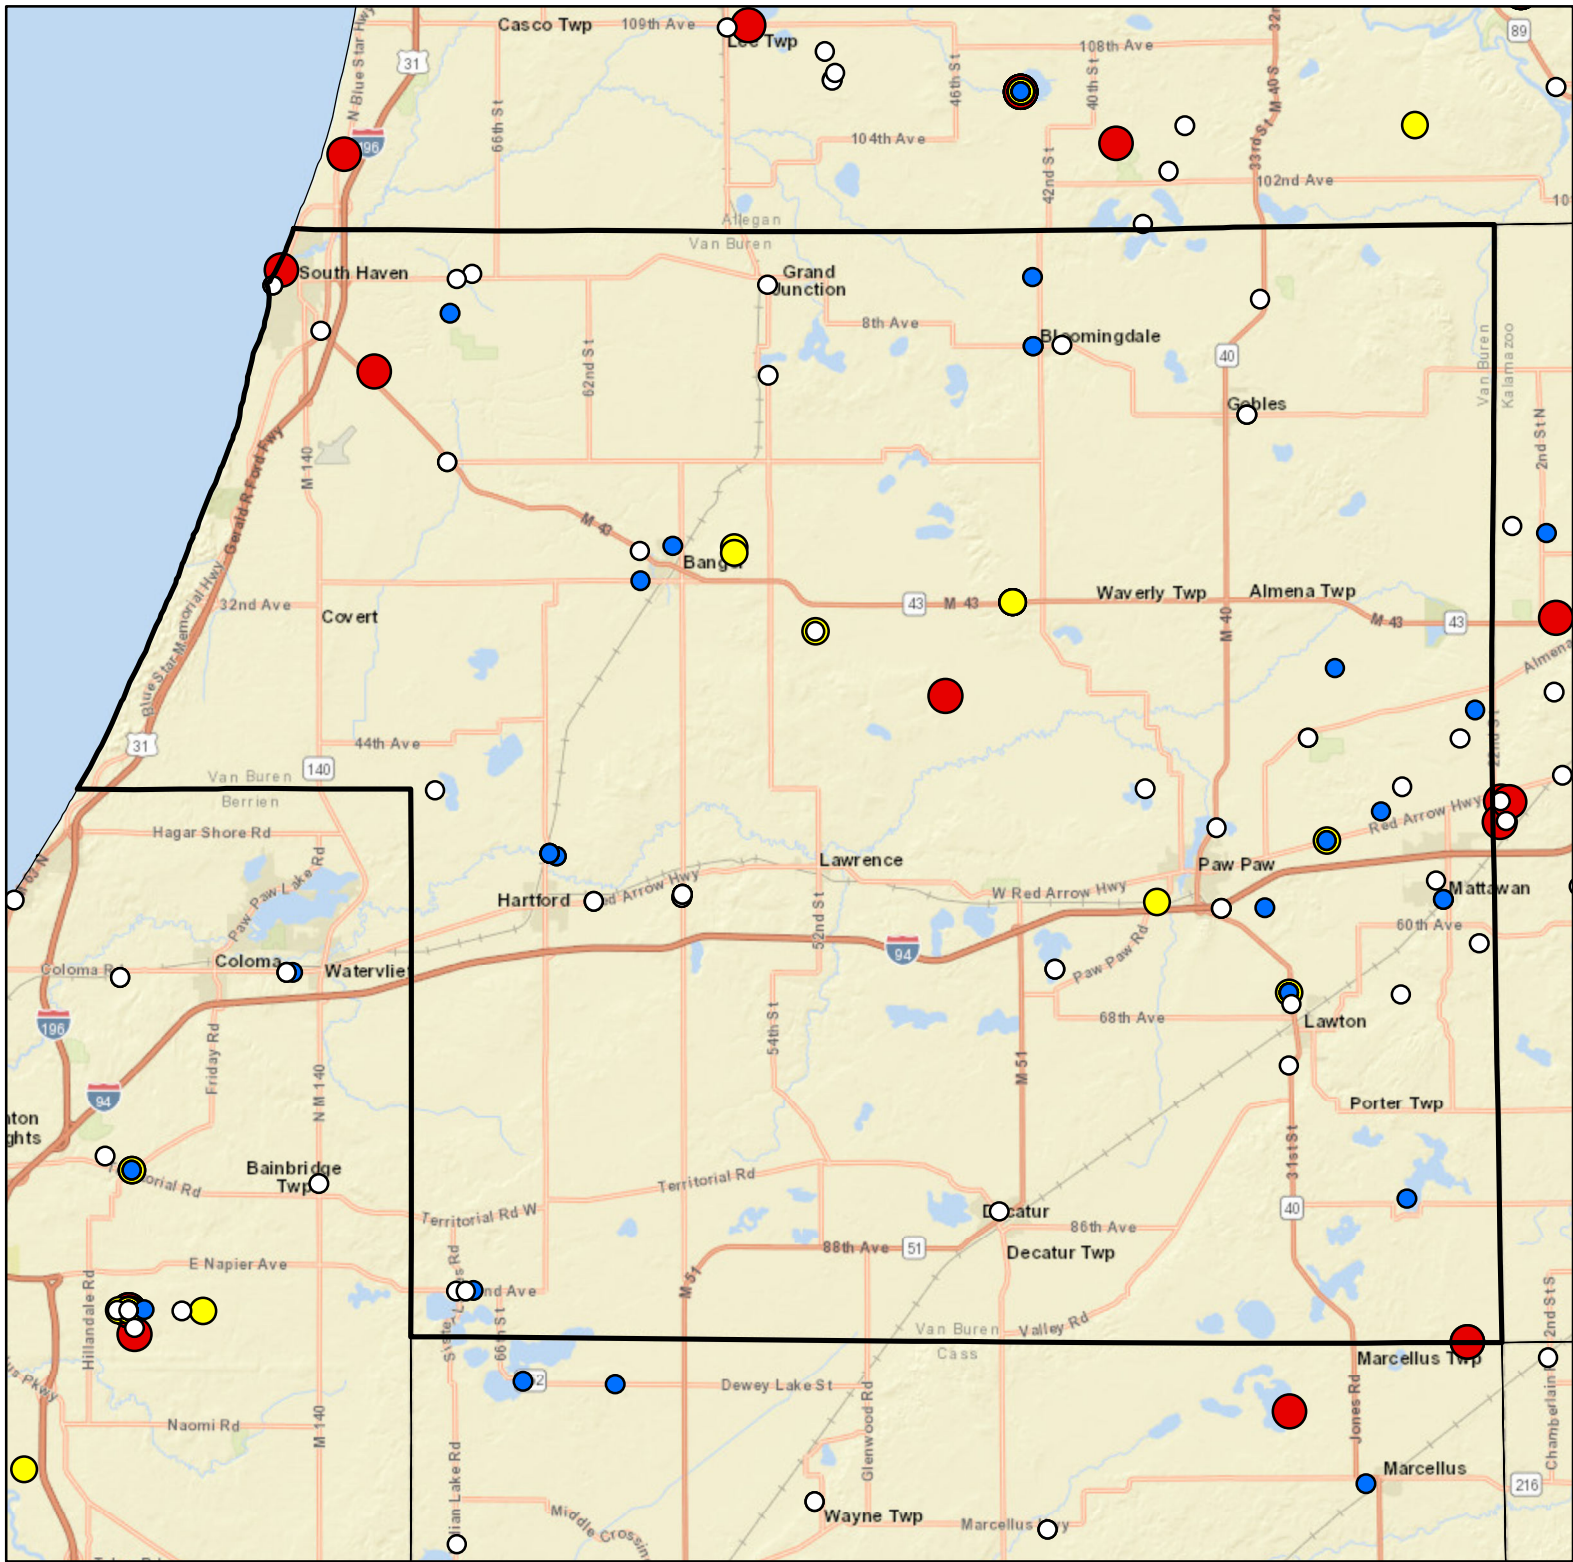


Van Buren County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

82 Total Samples



- > 10 6%
- 5-10 12%
- < 5 33%
- Non-Detect 49%




EGLE

0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

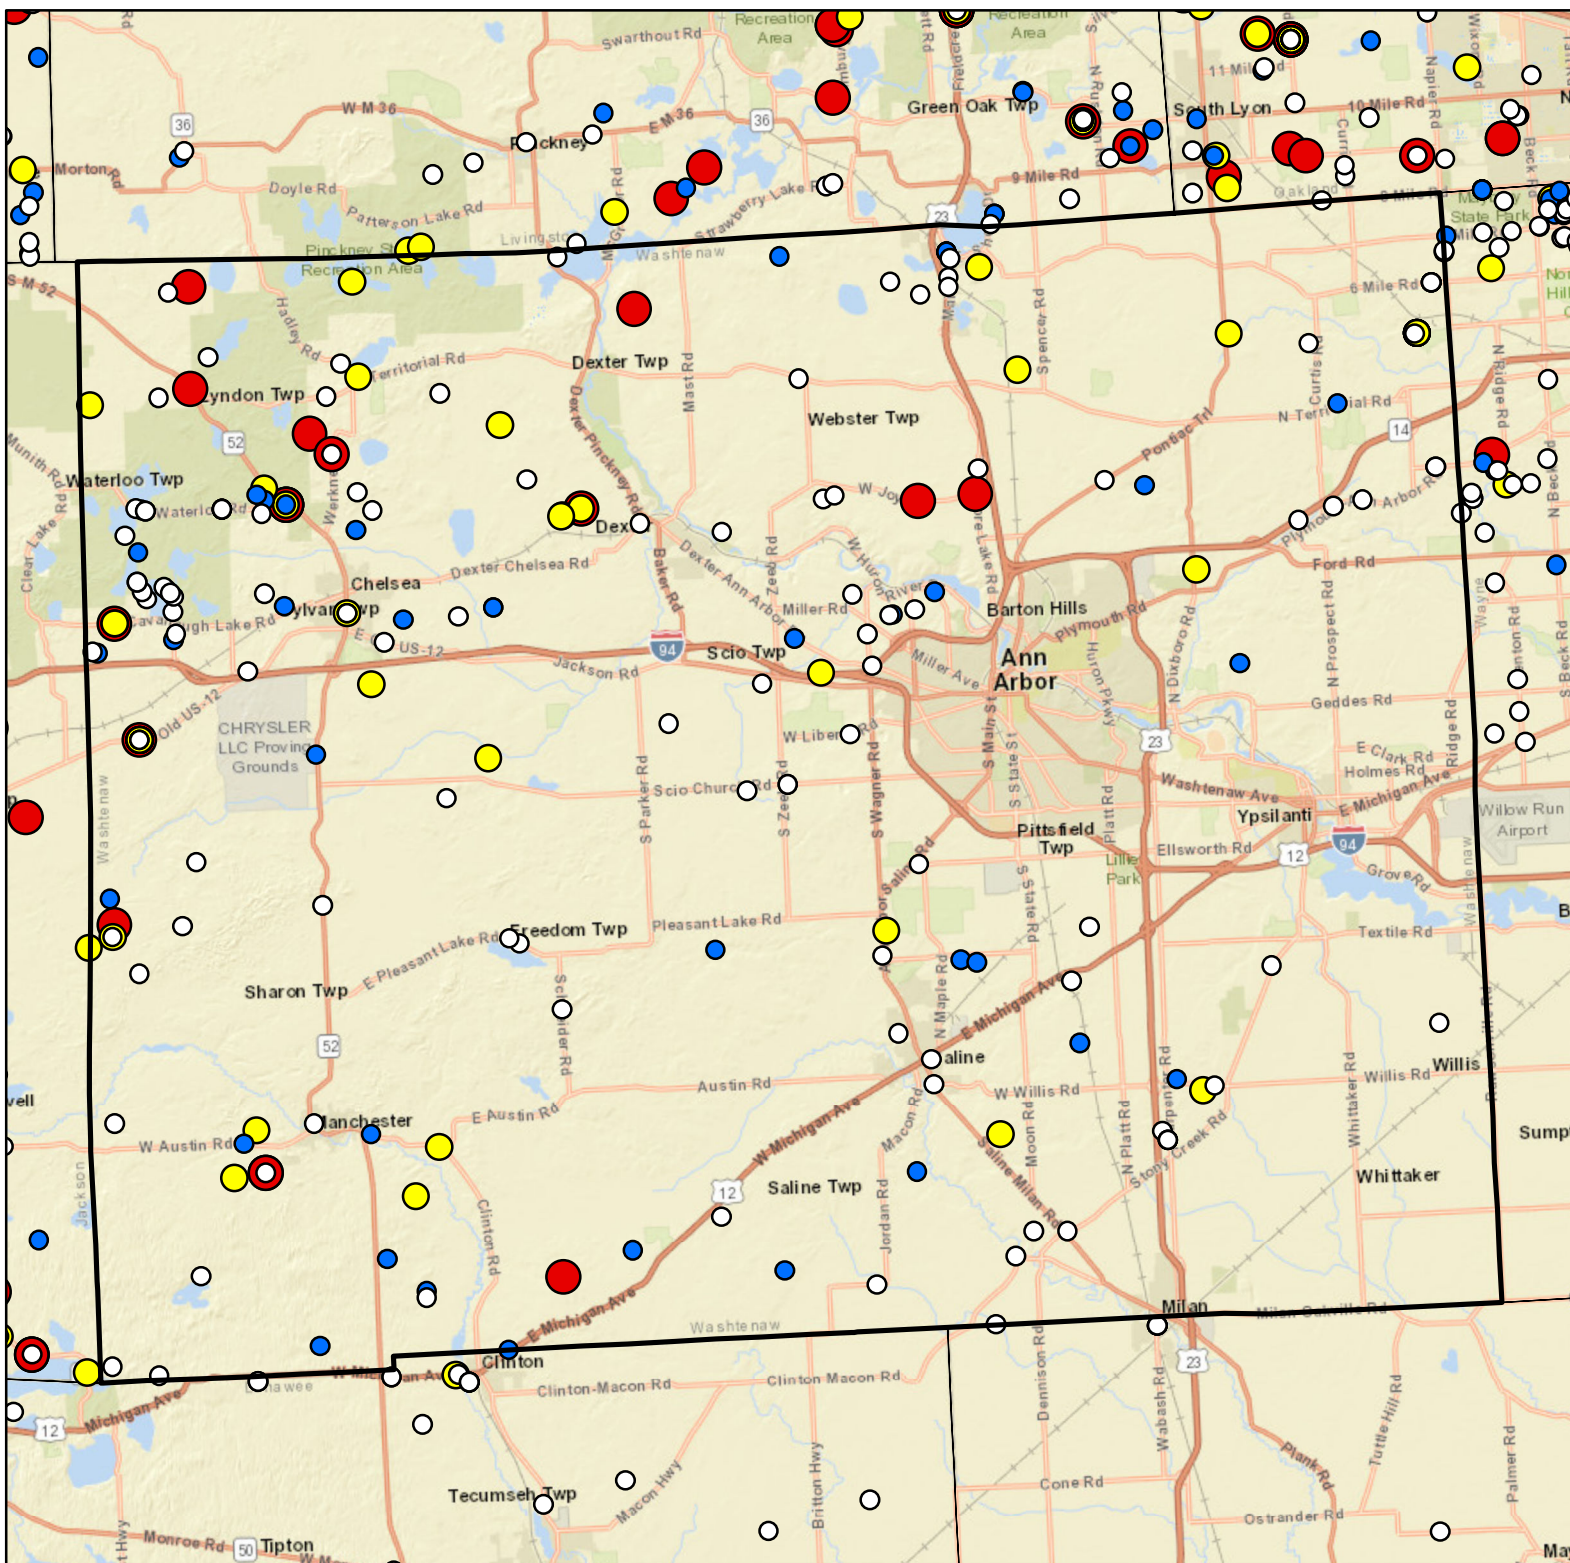


Washtenaw County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

238 Total Samples



- > 10 8%
- 5-10 15%
- < 5 29%
- Non-Detect 48%




EGLE

0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

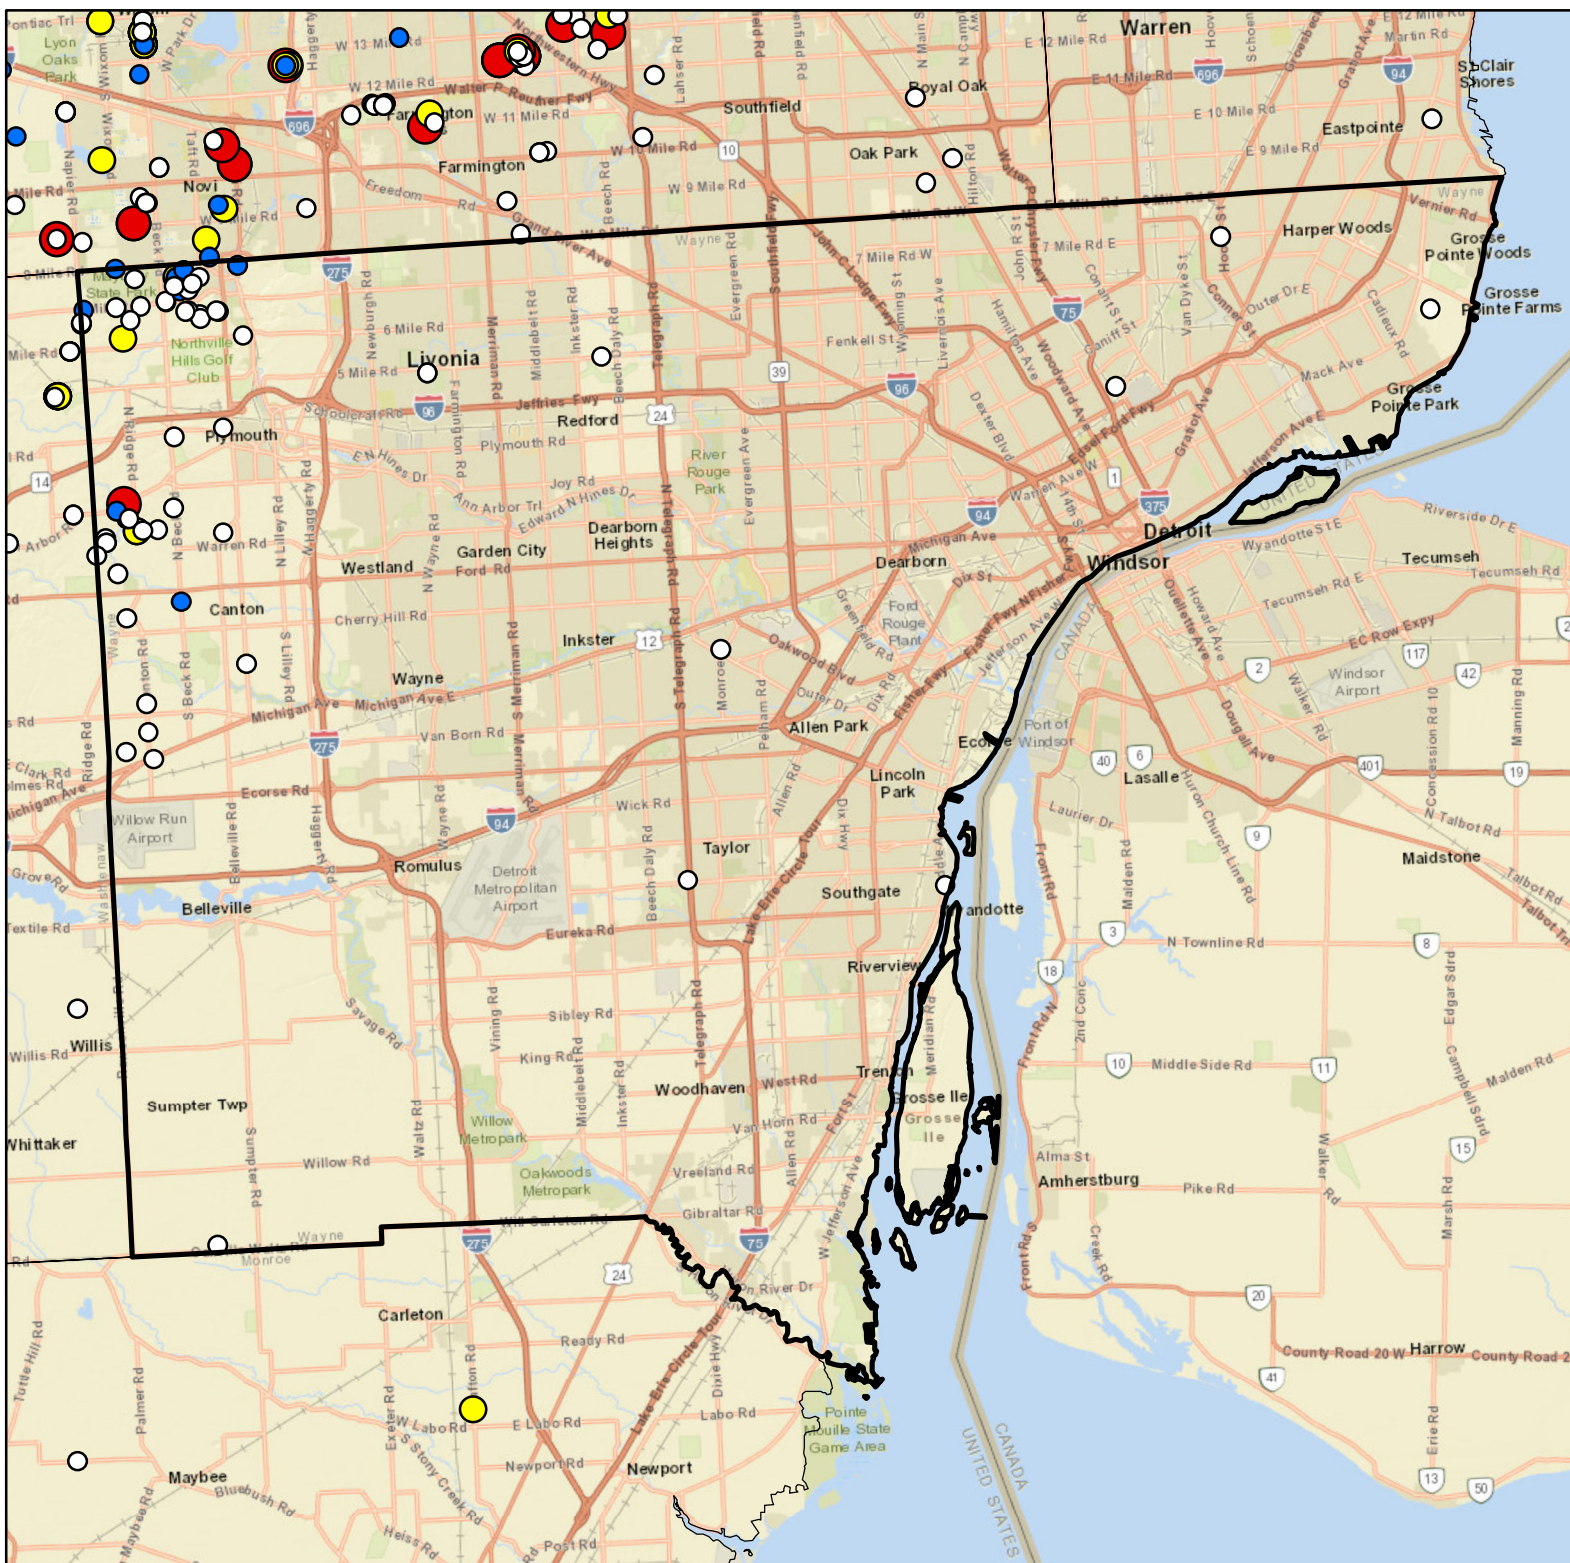


Wayne County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


74 Total Samples



- > 10 1%
- 5-10 6%
- < 5 31%
- Non-Detect 62%



Source: Waterchem database
Map Created November 2019

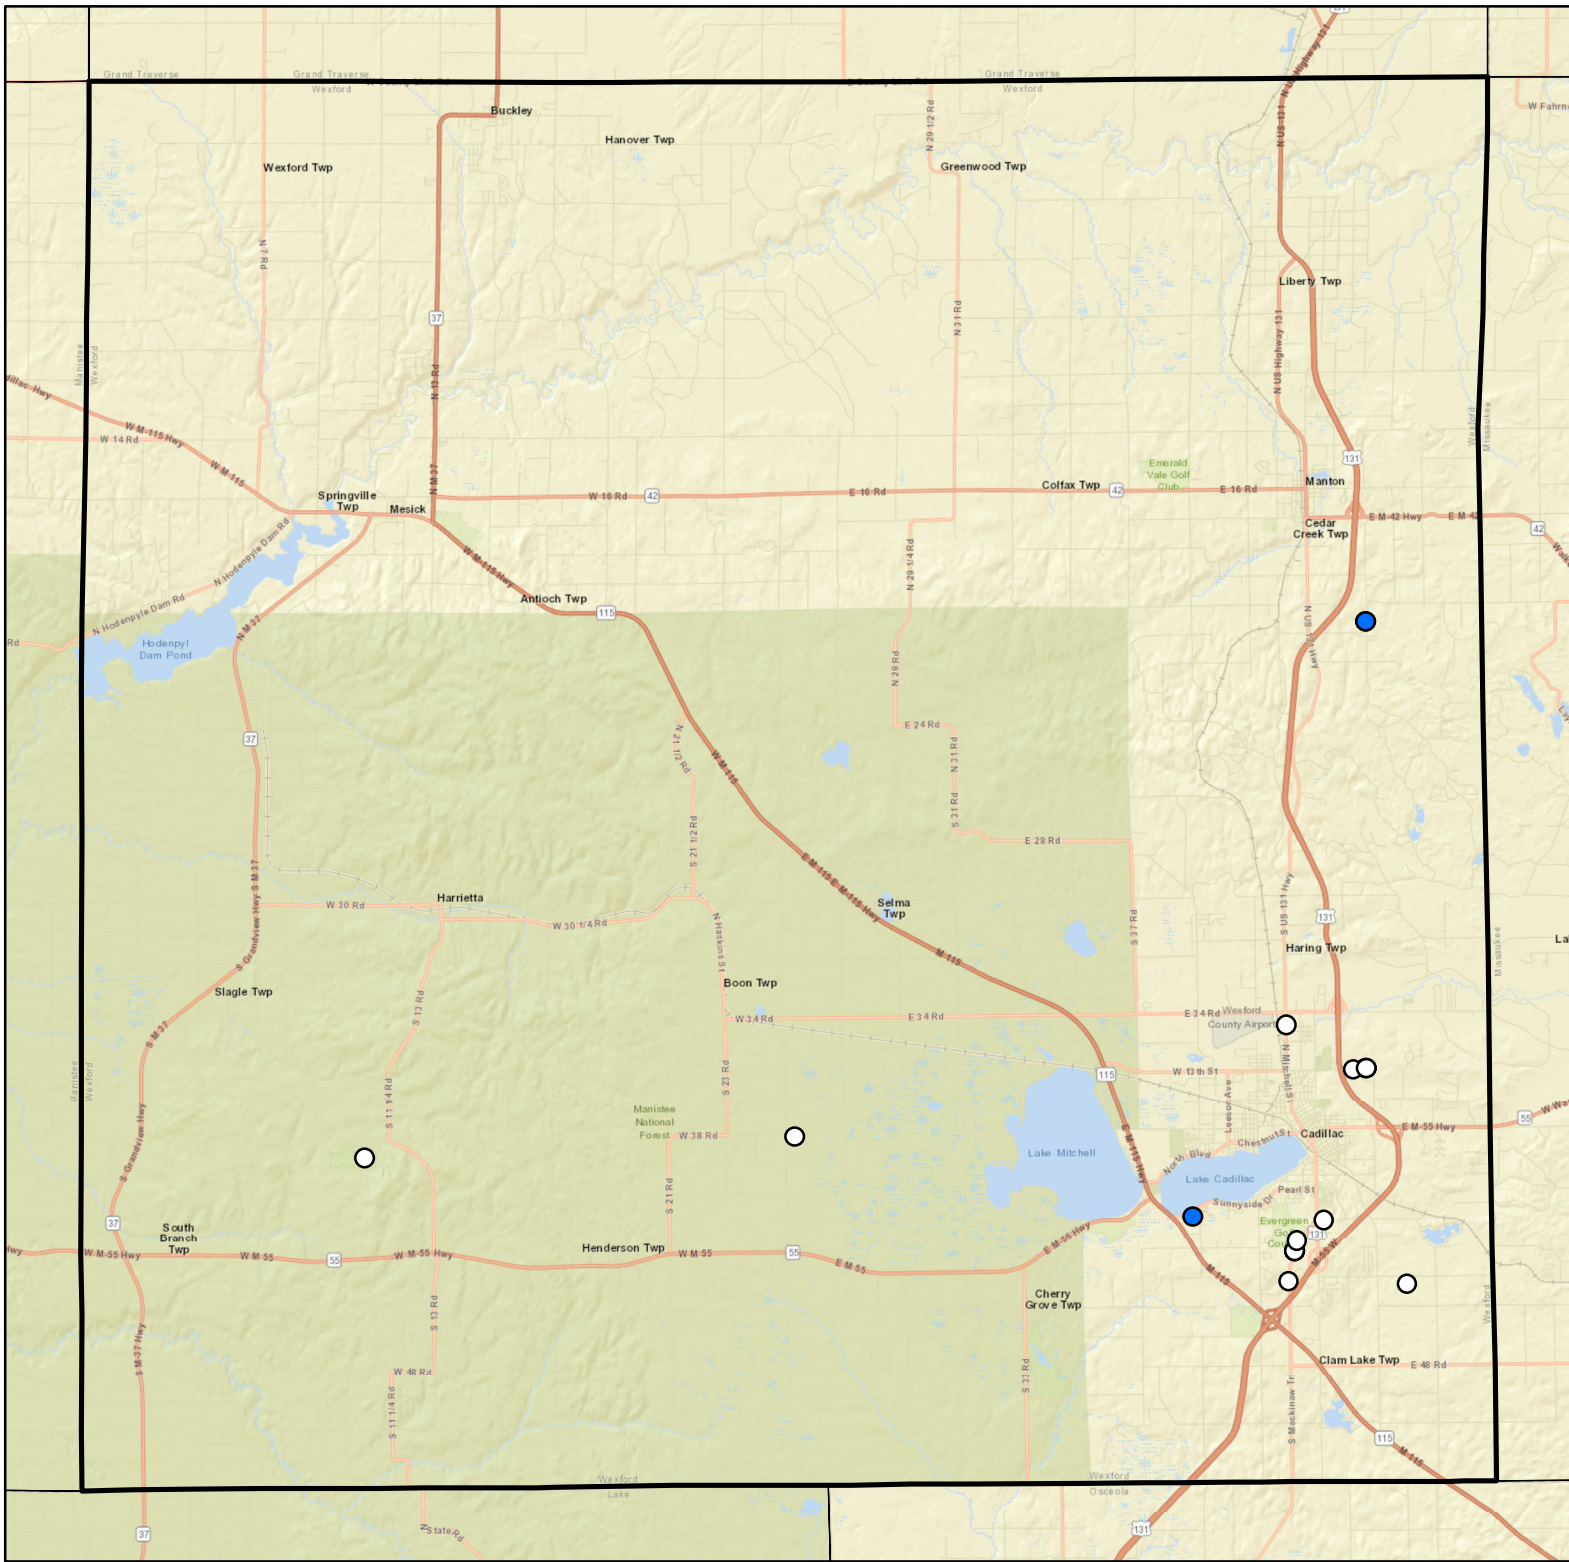


Wexford County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

16 Total Samples



- > 10 0%
- 5-10 0%
- < 5 12%
- Non-Detect 88%



Source: Waterchem database
Map Created November 2019